

Application Engineering

25 to 40 Ton ZP*KW Low Condensing Optimized Copeland Scroll™ Air Conditioning Compressors

BULLETIN NO: AE4-1401 R2

Contents

Safety			
Important Safety Information	3	Contaminant Control	10
Responsibilities, Qualifications and Training	3	Oil Type	11
Terminal Venting and Other Pressurized System Hazards	3	Three Phase Scroll Compressor Electrical Phasing	11
Flammable Refrigerant Hazards	4	Power Factor Correction	11
Electrical Hazards	4	Soft Starters	11
Hot Surface and Fire Hazards	4	Motor Overload Protection	11
Lifting Hazards	4	Motor Overload Protection Specs	11
POE Oil Hazards	4	Manifolded Compressors	12
Precautions	4	Manifolded Applications	12
Signal Word Definitions	6		
Introduction		VARIABLE SPEED OPERATION	
Nomenclature	7	Introduction	13
APPLICATION CONSIDERATIONS		Performance	13
Operating Envelope	7	Operating Envelope	13
Internal Pressure Relief (IPR) Valve	7	Drive Selection	13
Discharge Temperature Protection	8	Electrical Requirements	13
High Pressure Control	8	Autotuning	14
Low Pressure Control	8	Starting and Ramp Up	14
Shut Down Device	8	Stopping	14
Discharge Check Valve	8	Vibration	14
Shell Temperature	8	Oil Recovery Cycle	14
Compressor Cycling	8	Variable Speed Manifolded Applications	14
Long Pipe Lengths / High Refrigerant Charge	9	APPLICATION TESTS	
Suction and Discharge Fittings	9	Application Test Summary	14
System Tubing Stress	9	ASSEMBLY LINE PROCEDURES	
Accumulators	9	Compressor Handling	15
Off-Cycle Migration Control	9	Mounting	15
Crankcase Heat	9	Suction and Discharge Fittings	15
Pump Down Cycle	10	Assembly Line Brazing Procedure	15
Pump Out Cycle	10	Unbrazing System Components	15
Reversing Valves	10	Pressure Testing	16
		Assembly Line System Charging Procedure	16
		Electrical Connections	16
		“Hipot” (AC High Potential) Testing	16

MAY 2024

Tandem Assembly	17	Figure 1 - Nomenclature	20
SERVICE PROCEDURES		Figure 2 - 25 to 40 Ton Scroll Operating Envelope	21
Field Replacement	17	Figure 3 - Scroll Suction Tube Brazing	22
Mounting	17	Figure 4 - Crankcase Heater Location	22
Removing Oil	17	Figure 5a - ZP385/485 Terminal Box Wiring Diagram	23
Electrical	17	Figure 5b - ZP296 Terminal Box Wiring Diagram	23
Module	17	Figure 6 - Typical Rotalock Connected Tandem with TPTL Oil Manifold	24
Compressor Replacement after Motor Burn	18	Figure 7 - Typical Braze Connected Tandem with OEL Oil Manifold	24
Manifolded Compressor Replacement	18	Figure 8 - Typical Braze Connected Trio with TPTL Oil Manifold	25
Start-up of a New or Replacement Compressor	18	Figure 9 - Drive Output - Frequency vs. Voltage	25
Field Troubleshooting CoreSense Communications Module	18		
Copeland Scroll Compressor Functional Check	19		
TABLES AND FIGURES			
Table 1 - 20 to 40 Ton Copeland Scroll Family Features	7		
Table 2 - Torque Values	26		
Table 3 - Refrigerant Charge Limits	26		
Table 4 - Compressor Accessories	27		
Table 5 - Tandem Quick Reference Guide	28		
Table 6 - Trio Quick Reference Guide	29		
Table 7 - CoreSense Specifications	30		
Table 8 - CoreSense Communications			
LED Flash Code Information	31		
Table 9 - Copeland Drive Selections	32		

Safety


Important Safety Information

Those involved in the design, manufacture, and installation of a system, system purchasers, and service personnel may need to be aware of hazards and precautions discussed in this section and throughout this document. OEMs integrating the compressor into a system should ensure that their own employees follow this bulletin and provide any necessary safety information to those involved in manufacturing, installing, purchasing, and servicing the system.

Responsibilities, Qualifications and Training

- OEMs are responsible for system design, selection of appropriate components, integration of this component into the system, and testing the system. OEMs must ensure that staff involved in these activities are competent and qualified.
- OEMs are also responsible for ensuring that all product, service, and cautionary labels remain visible or are appropriately added in a conspicuous location on the system to ensure they are clear to any personnel involved in the installation, commissioning, troubleshooting or maintenance of this equipment.
- Only qualified and authorized HVAC or refrigeration personnel are permitted to install, commission, troubleshoot and maintain this equipment. Electrical connections must be made by qualified electrical personnel.
- Observe all applicable standards and codes for installing, servicing, and maintaining electrical and refrigeration equipment.

Terminal Venting and Other Pressurized System Hazards



If a compressor's electrical terminal pin loses its seal, pressurized oil, refrigerant, and debris may spray out. This is called "terminal venting".

The ejected debris, oil, and refrigerant can injure people or damage property. The oil and refrigerant spray can be ignited by electrical arcing at the terminal or any nearby ignition source, producing flames that may project a significant distance from the compressor. The distance depends on the pressure and the amount of refrigerant and oil mixture in the system. The flames can cause serious or fatal burns and ignite nearby materials.

Each compressor has a terminal cover or molded plug that covers electrical connections. The cover or plug helps to protect against electric shock and the risks of terminal venting. If terminal venting occurs, the cover or plug helps contain the spray of refrigerant and oil and reduces the risk of ignition. If ignition occurs, the plug or cover helps contain the flames. However, neither the terminal cover nor the molded plug can completely eliminate the risk of venting, ignition, or electric shock.

See [copeland.com/terminal-venting](https://www.copeland.com/terminal-venting) for more details about terminal venting. Additionally, a compressor's refrigerant lines keep refrigerant and oil under pressure. When removing or recharging refrigerant from this component during service, this can pose a pressurized fluid hazard.

Flammable Refrigerant Hazards



If flammable refrigerant is released from a system, an explosive concentration can be present in the air near the system. If there is an ignition source nearby, a release of flammable refrigerant can result in a fire or explosion. While systems using flammable refrigerant are designed to mitigate the risk of ignition if the refrigerant is released, fire and explosion can still occur.

See [copeland.com/flammable-refrigerants](https://www.copeland.com/flammable-refrigerants) for more information on flammable refrigerant safety.

Electrical Hazards



Until a system is de-energized, and capacitors have been discharged, the system presents a risk of electric shock.

Hot Surface and Fire Hazards



While the system is energized, and for some time after it is deenergized, the compressor may be hot. Touching the compressor before it has cooled can result in severe burns. When brazing system components during service, the flames can cause severe burns and ignite nearby combustible materials.

Lifting Hazards



Certain system components may be very heavy. Improperly lifting system components or the compressor can result in serious personal injury. Use proper lifting techniques when moving.

POE Oil Hazards

This equipment contains polyol ester (POE) oils. Certain polymers (e.g., PVC/CPVC and polycarbonate) can be harmed if they come into contact with POE oils. If POE oil contacts bare skin, it may cause an allergic skin reaction.

Precautions

- Always wear personal protective equipment (gloves, eye protection, etc.).
 - Keep a fire extinguisher at the jobsite at all times.
 - Keep clear of the compressor when power is applied.
- **IMMEDIATELY GET AWAY if you hear unusual sounds in the compressor. They can indicate that terminal pin ejection may be imminent. This may sound like electrical arcing (sizzling, sputtering or popping). However, terminal venting may still occur even if you do not hear any unusual sounds.**

- Never reset a breaker or replace a blown fuse without performing appropriate electrical testing
 - **A tripped breaker or blown fuse may indicate an electrical fault in the compressor. Energizing a compressor with an electrical fault can cause terminal venting. Perform checks to rule out an electrical fault.**
- Disconnect power and use lock-out/tag-out procedures before servicing.
 - Before removing the terminal cover or molded plug, check that ALL electrical power is disconnected from the unit. Make sure that all power legs are open. (Note: The system may have more than one power supply.)
 - Discharge capacitors for a minimum of two minutes
 - Always use control of hazardous energy (lock-out/tag-out) procedures to ensure that power is not reconnected while the unit is being serviced.
- Allow time for the compressor to cool before servicing.
 - Ensure that materials and wiring do not touch high temperature areas of the compressor.
- Keep all non-essential personnel away from the compressor during service.
 - For A3 refrigerants (R290) remove refrigerant from both the high and low sides of the compressor. Use a recovery machine and cylinder designed for flammable refrigerants. Do not use standard recovery machines because they contain sources of ignition such as switches, high- and low-pressure controls and relays. Only vent the R290 refrigerant into the atmosphere if the system is in a well-ventilated area. Never use a torch to remove the compressor. Only tubing cutters should be used.
- Never use a torch to remove the compressor. Only tubing cutters should be used for both A2L and A3 refrigerants.
- Use an appropriate lifting device to install or remove the compressor.
- Never install a system and leave it unattended when it has no charge, a holding charge, or with the service valves closed without electrically locking out the system.
- Always wear appropriate safety glasses and gloves when brazing or unbrazing system components.
- Charge the system with only approved refrigerants and refrigeration oils.
- Keep POE oils away from certain polymers (e.g., PVC/CPVC and polycarbonate) and any other surface or material that might be harmed by POE oils. Proper protective equipment (gloves, eye protection, etc.) must be used when handling POE lubricant. Handle POE oil with care. Refer to the Safety Data Sheet (SDS) for further details.
- Before energizing the system:
 1. Securely fasten the protective terminal cover or molded plug to the compressor, and
 2. Check that the compressor is properly grounded per the applicable system and compressor requirements.

Signal Word Definitions

The signal word explained below are used throughout the document to indicate safety messages.



DANGER indicates a hazardous situation which, if not avoided, will result in death or serious injury.



WARNING indicates a hazardous situation which, if not avoided, could result in death or serious injury.



CAUTION, used with the safety alert symbol, indicates a hazardous situation which, if not avoided, could result in minor or moderate injury.

Revision Tracking R2

The document format has been updated to the new Copeland format.

All occurrences of "Emerson" have been removed.

A note regarding A3 and R290 venting has been updated.

Introduction

The 25 to 40 ton ZP*KW Copeland Scroll™ compressors are designed and optimized for lower condensing temperature applications versus the ZP*KC air cooled condensing optimized compressors. Water cooled, evaporative cooled, or air cooled condensers with design condensing temperatures less than 110F will benefit from the increased efficiency of the ZP*KW compressors. Compressors in this family include a number of features outlined in Table 1 below.

Nomenclature

The model numbers of the 20 to 40 ton ZP*KC compressors include the approximate, nominal 60 Hertz capacity at the AHRI air conditioning condition (45°F evaporating, 130°F condensing, 20°F superheat, 15F subcooling). The ZP*KW compressors have the same displacement as the equivalent ZP*KC compressors and therefore have the same base model number. However, the ZP*KW compressors are rated at a different operating condition, 40°F evaporating, 100 condensing, 10°F superheat, 10°F subcooling. AHRI air conditioning operating condition is outside of the operating envelope of the ZP*KW compressors. See Figure 1 for more information regarding nomenclature.

APPLICATION CONSIDERATIONS

The following application guidelines should be considered during the design of a system using ZP*KW scroll compressors. Some of this information is recommended, whereas other guidelines must be followed.

The Application Engineering department will always welcome suggestions that will help improve these types of documents.

Operating Envelope

Figure 2 illustrates the operating envelope for the 25 to 40 ton ZP*KW compressors. Please take note of the 120F condensing temperature limit and the operating frequency ranges. The envelopes were developed with 10F suction superheat in the return gas. The steady-state operating condition of the compressor must remain inside the prescribed operating envelope.

Excursions outside of the envelope should be brief and infrequent.

Internal Pressure Relief (IPR) Valve



A high pressure control must be used in all applications.

The 25 to 40 ton Copeland Scroll compressors do not have internal pressure relief valves. **To avoid abnormally high operating pressures, a high pressure control must be used in all applications.**

If any type of discharge line shut-off valve is used, the high pressure control must be installed between the compressor discharge fitting and the valve. Compressors with rotalock discharge fittings have a connection on the rotalock fitting for the high pressure cut-out switch connection.

Table 1 - 20 to 40 Ton Copeland Scroll Family Features

Model	Refrigerant	Motor Protection	Communications ²	Tandem/Trio Manifolded Applications	Electrical Frequency Range
ZP296-485KWE-TE ¹	R-410A	Coresense	Yes	Yes	35-75 Hertz

¹ Last Character In Voltage Code (5=200/230-3-60, 200/220-3-50, D=460-3-60, 380/420-3-50, E=575-3-60, 7=380-3-60)

² Modbus via RS485

ASHRAE Standard 15 and UL 984/60335-2-34 requires a system pressure relief valve when the compressor displacement is greater than 50 CFM. The floating seal in the compressor effectively acts as a pressure-relief device during blocked discharge conditions. Please refer to UL File SA2337 to reference UL's acceptance of this method.

Discharge Temperature Protection

High discharge temperature protection is provided by an NTC thermistor probe in the discharge plenum of the scroll. The CoreSense M1-M2 contacts are opened if the discharge temperature exceeds the specified temperature. Discharge temperature data are stored in the CoreSense module and can be made available to a system controller.

High Pressure Control

A high pressure cut-out control must be used in all applications. The maximum cut out setting is 450 psig (31 bar) for R-410A. The high pressure control should have a manual reset feature for the highest level of system protection.

Low Pressure Control

A low pressure control is highly recommended for loss of charge protection and other system fault conditions that may result in very low evaporating temperatures. Even though these compressors have internal discharge temperature protection, loss of system charge will result in overheating and recycling of the motor overload protector. Prolonged operation in this manner could result in oil pump out and eventual bearing failure.

The low pressure cut-out setting will depend on the application type and minimum expected evaporating temperature. The low pressure cut-out should be selected to prevent compressor overheating and other system failure modes such as coil icing in air conditioning systems and frozen heat exchangers in chiller systems.

The minimum, recommended low pressure cut-out switch settings are:

- Air conditioning and chiller:
- 55 psig/3.8 bar (R-410A)

Shut Down Device

All scrolls in this size range have floating valve technology to mitigate shut down noise. Since Copeland Scroll™

compressors are also excellent gas expanders, they will rotate backwards for a brief period after shutdown as the internal pressures equalize.

Discharge Check Valve

High side to low side leak-back during the off cycle is accomplished with the floating valve technology on the muffler plate of the compressor. An external discharge check valve should be considered in some applications. The ZP*KW compressors do not have conventional discharge check valves like the comparable ZP*KC compressors.

Shell Temperature



Compressor top cap temperatures can be very hot. Care must be taken to ensure that wiring or other materials which could be damaged by these temperatures do not come into contact with these potentially hot areas.

Compressor Cycling

There is no set answer to how often scroll compressors can be started and stopped in an hour, since it is highly dependent on system configuration. There is no minimum off time because Copeland Scroll compressors start unloaded, even if the system has unbalanced pressures. The most critical consideration is the minimum run time required to return oil to the compressor after startup. To establish the minimum run time, obtain a sample compressor equipped with a sight tube (available from Copeland) and install it in a system with the longest connecting lines and highest internal volume that the system may have. **The minimum on time becomes the time required for oil lost during compressor startup to return to the compressor sump and restore a minimal oil level that will assure oil pick up through the crankshaft. The minimum oil level required in the compressor is 1.5" (40 mm) below the center of the compressor sight-glass. The oil level should be checked with the compressor "off" to avoid the sump turbulence when the compressor is running.** Cycling the compressor for a shorter period than this, for instance to maintain very tight temperature control, will result in progressive loss of oil and damage to the compressor.

CoreSense Communications provides a configurable short cycle protection feature.

Long Pipe Lengths / High Refrigerant Charge

Some systems may contain higher-than-normal refrigerant charges. Systems with large reheat coils, low ambient condenser flooding, or systems with multiple heat exchangers are among some system configurations that may require additional lubricant. Since the 25 to 40 ton scrolls have sight-glasses for oil level viewing, the oil level should always be checked during OEM assembly, field commissioning, and field servicing. An estimation of the amount of additional lubricant to add to the compressor(s) when the circuit charge exceeds 20 pounds of refrigerant is as follows:

Single compressor application: 0.5 fluid ounce of oil per pound of refrigerant

Tandem compressor application: 0.7 fluid ounce of oil per pound of refrigerant

Trio compressor application: 1.0 fluid ounce of oil per pound of refrigerant

The oil level must be carefully monitored during system development, and corrective action should be taken if the compressor oil level falls more than 1.5" (40 mm) below the center of the sight-glass. **The compressor oil level should be checked with the compressor "off" to avoid the sump turbulence when the compressor is running.**

These compressors are available to the OEM with a production sight-glass that can be used to determine the oil level in the compressor in the end-use application. These compressors are also available to the OEM with an oil Schrader fitting on the side of the compressor to add additional oil if needed because of long lengths of piping or high refrigerant charge. **No attempt should be made to increase the oil level in the sight-glass above the 3/4 full level. A high oil level is not sustainable in the compressor and the extra oil will be pumped out into the system causing a reduction in system efficiency and a higher-than-normal oil circulation rate.**

Suction and Discharge Fittings

25 to 40 ton ZP*KW Copeland Scroll compressors have copper plated steel suction and discharge or threaded rotalock fittings. See Figure 3 for assembly line and field

brazing recommendations and **Table 2** for rotalock torque requirements.

System Tubing Stress

System tubing should be designed to keep tubing stresses below 9.5 ksi (62 MPa), the endurance limit of copper tubing. Start, stop and running (resonance) cases should be evaluated.

Accumulators

The use of accumulators is very dependent on the application. The Copeland Scroll™ compressor's inherent ability to handle liquid refrigerant during occasional operating flood back situations makes the use of an accumulator unnecessary in most applications. In applications where uncontrolled flooding is common, an accumulator should be used to prevent excessive oil dilution and oil pump out.

Off-Cycle Migration Control

Excessive migration of refrigerant to the compressor during the off-cycle can result in oil pump-out on start up, excessive starting noise and vibration, bearing erosion, and broken scrolls if the hydraulic slugging pressure is high enough. For these reasons, off-cycle refrigerant migration must be minimized. The following three sections summarize off-cycle migration techniques.

Crankcase Heat

A crankcase heater is required when the system charge exceeds the values listed in **Table 3**. This requirement is independent of system type and configuration. **Table 4** lists Copeland crankcase heaters by part number and voltage. See **Figure 4** for the proper heater location on the compressor shell. **The crankcase heater must remain energized during compressor off cycles.**

The initial start-up in the field is a very critical period for any compressor because all load-bearing surfaces are new and require a short break-in period to carry high loads under adverse conditions. **The crankcase heater must be turned on a minimum of 12 hours prior to starting the compressor.** This will prevent oil dilution and bearing stress on initial start up.

To properly install the crankcase heater, the heater should be installed in the location illustrated in **Figure 4**. Tighten

the clamp screw carefully, ensuring that the heater is uniformly tensioned along its entire length and that the circumference of the heater element is in complete contact with the compressor shell. It's important that the clamp screw is torqued to the range of 20-25 in-lb (2.3-8 N-m) to ensure adequate contact and to prevent heater burnout. Never apply power to the heater in free air or before the heater is installed on the compressor to prevent overheating and burnout. **WARNING! Crankcase heaters must be properly grounded.**

Pump Down Cycle

Recycling pump down must not be used with ZP*KW compressors. In lieu of a pump down cycle, simply closing a liquid line solenoid valve when the compressor cycles off is a good, simple, and cost effective method of minimizing off-cycle refrigerant migration.

Pump Out Cycle

A pump out cycle has been successfully used by some manufacturers of large air conditioning systems. After an extended off period, a typical pump out cycle will energize the compressor for up to one second followed by an off time of 5 to 20 seconds. This cycle is usually repeated a second time, the third time the compressor stays on for the cooling cycle. A pump out cycle is usually initiated after a long compressor off-time, not after normal off-cycles.

If any of the above methods are employed, a crankcase heater must be used if the circuit charge amount exceeds the values listed in Table 3.

Reversing Valves

Since Copeland Scroll compressors have very high volumetric efficiency, their displacements are lower than those of comparable capacity reciprocating compressors. **CAUTION Reversing valve sizing must be within the guidelines of the valve manufacturer. Required pressure drop to ensure valve shifting must be measured throughout the operating range of the unit and compared to the valve manufacturer's data. Low ambient heating conditions with low flow rates and low pressure drop across the valve can result in a valve not shifting. This can result in a condition where the compressor appears to be not pumping (i.e. balanced pressures). It can also result in elevated compressor sound levels.** During a defrost cycle, when the reversing

valve abruptly changes the refrigerant flow direction, the suction and discharge pressures will go outside of the normal operating envelope. The sound that the compressor makes during this transition period is normal, and the duration of the sound will depend on the coil volume, outdoor ambient, and system charge level. The preferred method of mitigating defrost sound is to shut down the compressor for 20 to 30 seconds when the reversing valve changes position going into and coming out of the defrost cycle. This technique allows the system pressures to reach equilibrium without the compressor running. The additional start-stop cycles do not exceed the compressor design limits, but suction and discharge tubing design should be evaluated.

The reversing valve solenoid should be wired so that the valve does not reverse when the system is shut off by the operating thermostat in the heating or cooling mode. If the valve is allowed to reverse at system shutoff, suction and discharge pressures are reversed to the compressor. This results in pressures equalizing through the compressor which can cause the compressor to slowly rotate backwards until the pressures equalize. This condition does not affect compressor durability but can cause unexpected sound after the compressor is turned off.

Contaminant Control

Copeland Scroll™ compressors leave the factory with a miniscule amount of contaminants. Manufacturing processes have been designed to minimize the introduction of solid or liquid contaminants. Dehydration and purge processes ensure minimal moisture levels in the compressor, and continuous auditing of lubricant moisture levels ensures that moisture isn't inadvertently introduced into the compressor. During unit assembly and field servicing, compressors shouldn't be left open to the atmosphere for longer than 20 minutes.

It is generally accepted that system moisture levels should be maintained below 50 ppm. **A filter-drier is required on all POE lubricant systems to prevent solid particulate contamination, oil dielectric strength degradation, ice formation, oil hydrolysis, and metal corrosion.** It is the system designer's responsibility to make sure that the filter-drier is adequately sized to accommodate the contaminants from system manufacturing processes which leave solid or liquid contaminants in the evaporator coil, condenser coil, and interconnecting tubing plus any contaminants introduced during the field installation

process. Molecular sieve and activated alumina are two filter-drier materials designed to remove moisture and mitigate acid formation. A 100% molecular sieve filter can be used for maximum moisture capacity. A more conservative mix, such as 75% molecular sieve and 25% activated alumina, should be used for service applications.

Oil Type

Polyolester (POE) oil is used in ZP*KWE compressors for use with R-410A. See the compressor nameplate for the original oil charge. A complete recharge should be approximately four fluid ounces (118 ml) less than the nameplate value.

If additional oil is needed in the field for POE applications, Copeland™ Ultra 32-3MAF, Lubrizol Emkarate RL32-3MAF, Parker Emkarate RL32-3MAF/ (Virginia) LE32-3MAF, or Nu Calgon 4314-66 (Emkarate RL32-3MAF) should be used. Copeland™ Ultra 22 CC, Hatcol EAL 22CC, and Mobil EAL Arctic 22 CC are acceptable alternatives.

CAUTION: POE must be handled carefully and the proper protective equipment (gloves, eye protection, etc.) must be used when handling POE lubricant. POE must not come into contact with any surface or material that might be harmed by POE, including without limitation, certain polymers (e.g. PVC/CPVC and polycarbonate).

Three Phase Scroll Compressor Electrical Phasing

NOTICE

Compressors that employ CoreSense technology have phase protection and will be locked out after one reverse phase event.

Copeland Scroll compressors, like several other types of compressors, will only compress in one rotational direction. Three phase compressors will rotate in either direction depending upon phasing of the power. Since there is a 50% chance of connecting power in such a way as to cause rotation in the reverse direction, **it is important to include notices and instructions in appropriate locations on the equipment to ensure that proper rotation direction is achieved when the system is installed and operated.** Verification of proper rotation direction is made by observing that suction pressure drops

and discharge pressure rises when the compressor is energized. Reverse rotation will result in no pressure differential as compared to normal values. A compressor running in reverse will sometimes make an abnormal sound.

Power Factor Correction

If power factor correction is necessary in the end-use application, please see AE9-1249 for more information on this topic.

Soft Starters

Soft starters can be used with the 25 to 40 ton ZP*KW Copeland Scroll compressors to reduce inrush current. Soft starters should be selected in accordance with the soft starter manufacturer's recommendations, taking into consideration ambient temperature, number of starts per hour, and compressor amps. The maximum ramp up time should not exceed 3 seconds.

Motor Overload Protection



The CoreSense Communications modules are U.L. recognized safety devices and must be used with all compressors that have TE* electrical codes.

Models with Electrical Code TE

Compressors with an "E" in the electrical code (i.e. ZP296KWE-TED) employ CoreSense Communications as the motor overload protection device. CoreSense Communications provides advanced diagnostics, protection, and communications that enhance compressor performance and reliability. For more information please refer to the CoreSense Communications application engineering bulletin, **AE8-1384**.

Motor Overload Protection Specs

Table 7 summarizes the features and specifications for CoreSense Communications modules. Please see the **Field Troubleshooting** section for information on troubleshooting.

Manifolded Compressors

Tandem compressor assemblies are available for purchase from Copeland. In lieu of purchasing the assembled tandem, OEMs can purchase the manifoldready compressors and perform the assembly in their factory. Trio compressor assemblies are not available for purchase from Copeland. However, trio compressor designs have been developed and qualified. Drawings of tandem and trio compressor assemblies are available from Copeland by contacting your Application Engineer. **Tables 5 and 6** are quick reference guides to tandem and trio compressor assemblies respectively. Part numbers for manifolds and other service parts are available by contacting Application Engineering. **Figures 6, 7 and 8** show manifolded compressor assemblies. **NOTICE Customers who choose to design and build their own manifolds for tandem and trio compressor assemblies are ultimately responsible for the reliability of those manifold sets.**

The suction manifold is usually a symmetrical layout with the design intent of equal pressure drop to each compressor in the tandem or trio set. A straight length of pipe 18" (450 mm) or longer is required directly upstream of the suction manifold connection for all tandems and trios. The straight pipe serves as a flow straightener to make the flow as uniform as possible going into the suction manifold. Some tandem and trio assemblies use flow washers to assist with oil balancing between the compressors. Please refer to **Tables 5 and 6** for a complete list of all tandem and trios and required flow washers. For reference, refer to **Figures 6, 7, and 8** for compressor A-B-C identification in tandem and trio configurations. Compressor "A" is always on the left side of the assembly, when looking at the assembly from the terminal box side of the compressors.

The discharge manifold is the less critical of the two manifolds in terms of pressure drop and flow. Low pipe stress and reliability are its critical design characteristics. Manifolded options with bidirectional discharge manifolds will obviously need to have one of the outlets capped by the OEM or end-user. The overall length of the cap fitting shouldn't exceed 3" (7.6 cm). If the bidirectional manifold is clamped to the unit to provide discharge line stability, the clamp must be installed at least 15" (38 cm) downstream of the manifold. Clamping in this method will provide some flexibility between the manifold and the clamp.

Two different oil balancing techniques are used with tandems in this family of compressors - two-phase tandem line (TPTL) and oil equalization line (OEL). For trio assemblies, only the TPTL design has been qualified. The TPTL design is a larger diameter pipe connecting the oil sumps of the individual compressors allowing both gas and oil to flow between the compressors at the same time. To install the TPTL, the individual sight-glasses on each compressor must be removed to allow the TPTL to screw on to the sight-glass fitting on the compressors. A sight-glass is installed on the TPTL to view the presence of oil (see **Figure 6**).

The OEL design is a 5/8" (16 mm) copper tube connecting the oil sumps of the individual compressors allowing the flow of oil between the compressor sumps. To install the OEL, the oil drain Schrader fitting on each compressor must be removed so the OEL line can be screwed on to the individual rotalock oil fittings (see **Tandem Assembly** section). The OEL has an oil drain Schrader fitting on the 5/8" OEL tube for adding/ removing oil (see **Figure 7**). The OEL design allows the individual oil levels in each compressor to be viewed, which isn't possible with the TPTL.

Manifolded Applications

NOTICE

Manifolded compressor designs employ a passive oil management system. All system designs must be tested by the OEM to ensure that the passive design will provide adequate oil balancing between the compressors in the manifolded set under all operating conditions. If adequate oil balancing can't be demonstrated, an active oil management system must be used.

Manifolded compressors follow the same application guidelines as single compressors outlined in this bulletin. The refrigerant charge limit for tandem compressors is shown in **Table 3**. A tandem circuit with a charge over this limit must have crankcase heaters applied to both compressors.

The direction of the suction gas flow into the 18" (457 mm) straight pipe, directly upstream of the suction manifold, is critical for trio assemblies. The direction of flow is noted for each trio assembly in **Table 6** and on the individual trio assembly drawings. **The direction of flow is critical for**

oil balancing between the compressors and the noted direction of flow must be followed.

Oil levels in the individual sight-glasses will vary, depending on whether one or more compressors in the manifolded set are operating and if the manifolded set is made up of equal or unequal compressor capacities.

Because of the unequal oil levels that can exist, oil levels should be viewed with the compressors off to allow the oil level to stabilize between the compressor sumps. With the compressors off, oil should be visible in the individual compressor sightglasses when the OEL is used, or in the sight-glass on the TPTL. If oil is not visible, additional oil should be added to the system. **The above procedure is extremely important during the unit commissioning process in the field and must be performed. Failure to add oil to the system to account for large refrigerant charges and large internal surface areas can result in compressor failure.**

Suction and discharge tandem manifolds are not designed to support system piping. Support means must be provided by the system designer to support suction and discharge lines so that stress is not placed on the manifolds.

Compressors in a manifolded set must be started and stopped sequentially to keep manifold stresses as low as possible.

Please consult with Application Engineering during the development of systems with trio compressor assemblies. Trio compressor assemblies are sensitive to system operating conditions and configurations which will affect oil balancing. Trio compressor assemblies must be qualified for each application.

VARIABLE SPEED OPERATION

Introduction

The 25 to 40 ton ZP*KW Copeland Scroll compressors described in this bulletin are qualified for a speed range of 2100 to 4500 RPM, which corresponds to an electrical input frequency of 35 to 75 Hertz.

Performance

Ten coefficients are available for calculating performance. Evaporating and condensing temperature are the terms for the ten coefficient equation to calculate mass flow, power, and capacity. Twenty coefficients are also available for calculating performance. Evaporating and condensing

temperature and speed are the terms of the equation. The coefficients are for the compressor only and do not account for the drive. These coefficients are available by contacting Application Engineering.

Operating Envelope

The variable speed operating envelope is shown in Figure 2. Please note that the 35 to 75 Hertz (2100 to 4500 RPM) range does not apply to the entire envelope. The system controller must have the ability to keep the operating condition inside of the prescribed operating envelope

Drive Selection

A third party drive must be selected and sourced separately for the compressor.

Electrical Requirements

The drive must be sized to accommodate the maximum expected running amps of the compressor. The Control Techniques Drives in **Table 9** are selected based on the maximum current published in the operating envelope at rated voltage. For operation throughout the operating envelope at +/-10% voltage variation the drive should be selected based on the compressor maximum continuous current (MCC).

The recommended switching frequency of the drive is 2 to 3 kHz. Higher switching frequencies can result in motor overheating and reduced efficiency.

The normal ratio of the voltage/frequency should be kept constant throughout the 35 to 60 Hertz range. At frequencies higher than 60 Hertz, the voltage/ frequency ratio cannot be kept constant because the output voltage of the drive cannot be higher than the drive input voltage. **Figure 9** illustrates the voltage/frequency curves for nominal 230, 460, and 575 volt power supplies.

The CoreSense Communications M1-M2 contacts and other safety/protection controls (i.e. high pressure cut-out switch) should be wired in-series with the compressor contactor coil. The compressor contactor should be wired upstream of the variable frequency drive so the drive and compressor are immediately stopped when a safety/protection control trips.

Autotuning

If an Autotuning drive sequence is to be performed with a compressor that has a Coresense Communication module, the following steps must be taken.

1. De-energize control circuit and module power. Remove the control circuit wires from the module (terminals M1 & M2). Connect a jumper across these "control circuit" wires. This will bypass the "control contact" of the module.
CAUTION! The motor protection system within the compressor is now bypassed. Use only temporarily during autotuning sequence.
2. Run the Autotuning sequence of the drive.
3. Remove jumper and reconnect control circuit wires to the module.

Starting and Ramp Up

The starting frequency should be equal to or greater than 35 Hertz. After starting the compressor at a minimum of 35 Hertz, the frequency should be ramped up to 50 or 60 Hertz within 3 seconds. The compressor should operate at 50/60 Hertz for a minimum of 10 seconds before ramping the speed up or down to the desired operating speed. A normal ramp speed is 200 revolutions per second.

Stopping

Ramping down the frequency to 35 Hertz before stopping the drive-compressor is considered a good shutdown routine. However, given the operating frequency and speed range of the compressor it is not necessary to decelerate the compressor prior to shutdown. Depending on the drive interface and control, the drive should be given a "stop" command to stop the compressor. In rare cases when a system protection device trips (i.e. high pressure cut-out switch) power to the drive input should be immediately interrupted.

Vibration

A compressor driven at a variable speed will impose different frequencies at each speed, so the framework and piping design to accommodate vibration throughout the speed range can be more complex. As a rule of thumb, the system should be designed, or the drive control should be configured (skip frequencies program), such that there is no operation at resonant frequencies between 35 and 75 Hertz.

Oil Recovery Cycle

Particular attention must be given to the system refrigerant pipe size with the variable speed scrolls. ASHRAE guidelines for pipe sizing should be followed to ensure that refrigerant velocities are high enough at low speeds to ensure oil return to the compressor. At the same time, high refrigerant velocities at high speed operation can result in excessive pressure drop and loss of system efficiency. A careful evaluation and compromise in pipe sizing will likely have to be settled upon. A compressor sample with a sight-tube for monitoring the oil level should be used during system development to ensure an adequate oil level is maintained during all operating conditions and speeds.

If testing shows a gradual, continuous loss of oil in the compressor sight-tube over long run cycles at low speed, an oil recovery cycle should be incorporated into the system logic. A recovery cycle is accomplished by ramping the compressor up to a higher speed to increase the refrigerant flow rate to flush or sweep oil back to the compressor. How often a recovery cycle is initiated depends on many variables and would have to be determined through testing for each system type and configuration. A default method could be to initiate a recovery cycle at regular intervals.

Variable Speed Manifolded Applications

The most favorable oil balancing occurs when a VFD is applied to both compressors in the tandem set and the two-phase tandem line (TPTL) is used. See the prior section on **Manifolded Compressors** for a complete description of manifolded compressors and oil balancing. If only one VFD is applied to one compressor in a tandem set, the VFD should be applied to the compressor in the "A" position (see **Figure 7**). Trio manifolded compressor configurations have not been tested and qualified for variable speed operation.

APPLICATION TESTS

Application Test Summary

There are a minimal number of tests the system designer will want to run to ensure the system operates as designed. These tests should be performed during system development and are dependent on the system type and amount of refrigerant charge. These application tests are

to help identify gross errors in system design that may produce conditions that could lead to compressor failure.

For manifolded compressor assemblies, oil balancing tests must be performed to demonstrate oil balancing between the compressors. Compressors with sighttubes for viewing a wide range of oil levels is appropriate for this type of testing. The least amount of testing will evaluate the minimum and maximum flow conditions at which the compressors will be required to operate, with min and max suction superheat.

For variable speed applications, the above oil balancing and system oil return tests must be performed. The concern is a very low oil level after extended hours of operation at low speed (35 Hertz). In addition to oil balancing and system oil return tests, the suction and discharge tubing must be evaluated to determine the resonant frequencies. Once the resonant frequencies are known, they can be shifted to a safe range by changing the mass of the line for constant speed applications or they can be avoided for variable speed applications.

As always, Application Engineering is available to recommend additional tests and to evaluate test results.

ASSEMBLY LINE PROCEDURES

Compressor Handling

WARNING

Use care and the appropriate material handling equipment when lifting and moving compressors. Personal safety equipment must be used.

The suction and discharge plugs should be left in place until the compressor is set into the unit. If possible, the compressor should be kept vertical during handling. The discharge connection plug should be removed first before pulling the suction connection plug to allow the dry air pressure inside the compressor to escape. Pulling the plugs in this sequence prevents oil mist from coating the suction tube making brazing difficult. **The copper coated steel suction tube should be cleaned before brazing (see Figure 3).** No object (e.g. a swaging tool) should be inserted deeper than two inches (51 mm) into the suction tube, or it might damage the suction screen and motor.

Mounting

The tested rubber mounting grommet and sleeve kit is listed in **Table 4**.

Many OEM customers buy the mounting parts directly from the supplier, but Copeland's grommet design and durometer recommendations should be followed for best vibration reduction through the mounting feet. Please see AE4-1111 for grommet mounting suggestions and supplier addresses.

Suction and Discharge Fittings

These compressors are available with stub tube or rotalock connections. The stub tube version has copper-plated steel suction and discharge fittings. Due to the different thermal properties of steel and copper, brazing procedures may have to be changed from those commonly used. See Figure 3 for assembly line and field brazing procedures and Table 2 for Rotalock torque values.

Assembly Line Brazing Procedure

WARNING

Personal safety equipment must be used during brazing operation. Heat shields should be used to prevent overheating or burning nearby temperature sensitive parts. Fire extinguishing equipment should be accessible in the event of a fire.

Figure 3 discusses the proper procedures for brazing the suction and discharge lines to a scroll compressor. **NOTICE It is important to flow nitrogen through the system while brazing all joints during the system assembly process.** Nitrogen displaces the air and prevents the formation of copper oxides in the system. If allowed to form, the copper oxide flakes can later be swept through the system and block screens such as those protecting capillary tubes, thermal expansion valves, and accumulator oil return holes. The blockage - whether it is of oil or refrigerant - is capable of doing damage resulting in compressor failure.

Unbrazing System Components

WARNING

Before attempting to braze, it is important to recover all refrigerant from both the high and low side of the system.

If the refrigerant charge is removed from a scroll-equipped unit by evacuating the high side only, it is possible for the scrolls to seal, preventing pressure equalization through the compressor. This may leave the low side shell and suction line tubing pressurized. If a brazing torch is then applied to the low side while the low side shell and suction line contain pressure, the pressurized refrigerant and oil mixture could ignite when it escapes and contacts the brazing flame. **CAUTION!**

It is important to check both the high pressure and low pressure sides with manifold gauges before unbrazing. Instructions should be provided in appropriate product literature and assembly (line repair) areas. If compressor removal is required, the compressor should be cut out of system rather than unbrazed. See **Figure 3** for the proper compressor removal procedure.

Pressure Testing



Never pressurize the compressor to more than 475 psig (32.8 bar) for ZP*KWE compressors. Never pressurize the compressor from a nitrogen cylinder or other pressure source without an appropriately sized pressure regulating and relief valve.

Higher pressure may result in permanent deformation of the compressor shell and possibly cause misalignment or bottom cover distortion.

Assembly Line System Charging Procedure

Systems should be charged with liquid on the high side to the extent possible. The majority of the charge should be pumped in the high side of the system to prevent low voltage starting difficulties, hipot failures, and bearing washout during the first-time start on the assembly line. If additional charge is needed, it should be added as liquid to the low side of the system with the compressor operating. Pre-charging on the high side and adding **liquid** on the low side of the system are both meant to protect the compressor from operating with abnormally low suction pressures during charging. **NOTICE Do not operate the compressor without enough system charge to maintain at least 55 psig (3.8 bar) suction pressure for R-410A. Do not operate the compressor with the low pressure cut-out disabled. Do not operate with a restricted suction or liquid line. Do not use the compressor to test the opening set point of a high**

pressure cutout. Bearings are susceptible to damage before they have had several hours of normal running for proper break in.

Electrical Connections

The orientation of the electrical connections on the Copeland Scroll™ compressors is shown in **Figure 5**. The T-block screw terminals used on this compressor should be fastened with a torque of 21 to 25 in-lb (2.37 to 2.82 Nm). See **Table 2**.

Every effort should be made to keep the terminal box completely sealed. Oversized conduits, poor conduit connections to the terminal box, an incorrectly installed terminal box cover or a missing terminal box cover gasket are a few possible air leakage paths. **CAUTION! Moisture from warm, moist air that is permitted to freely enter the terminal box can condense into droplets of water inside the cooler terminal box of the compressor. To alleviate this problem, the warm, moist air must be prevented from entering the terminal box. Sealing conduits and eliminating other air leakage paths must be taken. Dow Corning 3165 RTV is ideally suited for sealing around wires in a conduit at the compressor terminal box. Drilling a hole in the bottom of the terminal box to allow the moisture to escape is not acceptable.**

“Hipot” (AC High Potential) Testing



Use caution with high voltage and never hipot when compressor is in a vacuum.

Copeland Scroll compressors are configured with the motor down and the pumping components at the top of the shell. As a result, the motor can be immersed in refrigerant to a greater extent than hermetic reciprocating compressors when liquid refrigerant is present in the shell. In this respect, the scroll is more like semi-hermetic compressors which can have horizontal motors partially submerged in oil and refrigerant. When Copeland Scroll compressors are hipot tested with liquid refrigerant in the shell, they can show higher levels of leakage current than compressors with the motor on top. This phenomenon can occur with any compressor when the motor is immersed in refrigerant. The level of current leakage does not present any safety issue. To lower the current leakage reading, the

system should be operated for a brief period of time to redistribute the refrigerant to a more normal configuration and the system hipot tested again. See **AE4-1294** for Megohm testing recommendations. **Under no circumstances should the hipot test be performed while the compressor is under a vacuum.**

Tandem Assembly

The following procedure outlines the basic steps to assemble a tandem.

1. Mount both compressors to the rails using the appropriate hardware. Mounting bolts should be snug, but not tight, so some movement of the compressor is possible for aligning the manifolds.
2. Install the suction and discharge manifolds. If the manifolds are brazed to the compressors following the brazing guide in **Figure 3**. If the manifolds are connected to the compressors with rotalocks torque the rotalocks to the value specified in **Table 2**.
3. Tilt the tandem assembly back approximately 12 degrees from horizontal so the oil flows away from the oil fittings and sight-glasses on the compressors. This can be accomplished by placing 4x4 wood blocks under the tandem rail closest to the oil fittings on the compressors. Install the oil manifold (TPTL or OEL) to the individual compressors and torque the rotalock fittings to the value specified in **Table 2**.
4. Torque the compressor to rail mounting bolts to the value specified in Table 2.

For a detailed instruction list of how to assemble a trio of compressors, please contact Application Engineering.

SERVICE PROCEDURES



POE oil must be handled carefully and the proper protective equipment (gloves, eye protection, etc.) must be used when handling POE lubricant. POE must not come into contact with any surface or material that might be harmed by POE, including without limitation, certain polymers (e.g. PVC/CPVC and polycarbonate).

Field Replacement



Use care and the appropriate material handling equipment when lifting and moving compressors. Personal safety equipment must be used.

Mounting

Soft or semi-hard mounting grommets, if used, should be replaced when the compressor is replaced. Grommet hardness can change over time when exposed to various ambient conditions. Rigid mounting hardware can probably be reused with the replacement compressor and should be evaluated by the service technician.

Removing Oil

If the oil level is higher than the oil Schrader fitting on the sump of the compressor oil can be drained from this fitting until the oil level reaches the level of the when the oil level is below the oil Schrader fitting one of two different procedures can be used. The first procedure is to remove the compressor from the system and drain the oil from the compressor suction connection. This method ensures complete removal of the oil from the compressor. The second procedure is to remove the compressor sight-glass and insert a hose into the sump of the compressor and draw the oil out with a hand-held pump (Yellow Jacket Pump UPC#77930).

Electrical

When replacing a compressor, especially one that has been in the field for a number of years, it is always a good idea to replace the contactor.

Note: See the locked rotor on the nameplate of the new compressor and make sure the contactor exceeds this locked rotor rating.

Module

Please refer to **AE8-1384** for information on CoreSense module configuration.

Compressor Replacement after Motor Burn

In the case of a motor burn, the majority of contaminated oil will be removed with the compressor. The rest of the oil is cleaned through use of suction and liquid line filter dryers. A 100% activated alumina suction filter drier is recommended but must be removed after 72 hours. See **AE24-1105** for clean up procedures and **AE11-1297** for liquid line filter-drier recommendations.

NOTICE It is highly recommended that the suction accumulator be replaced if the system contains one.

This is because the accumulator oil return orifice or screen may be plugged with debris or may become plugged shortly after a compressor failure. This will result in starvation of oil to the replacement compressor and a second failure.

Manifolded Compressor Replacement



When lifting manifolded compressor assemblies, all compressors must be lifted by their respective lifting rings. Use care and exercise extreme caution when lifting and moving compressors. Personal safety equipment must be used.

In the event that a compressor should fail in a manifolded set, only the failed compressor should be replaced. The oil from the failed compressor will stay mostly in the failed compressor. Any contaminated oil that does enter the other compressor sumps will be cleaned by the liquid line filter drier, and when used, the suction line filter drier.

Changing a compressor in a manifolded set that uses rotalock connected manifolds simplifies the changeout process. After the refrigerant is recovered, and it is verified through the use of gauges that no residual refrigerant pressure is in the section of the system being serviced, the suction and discharge rotalock fittings can be disconnected from the failed compressor. Always use new rotalock o-ring seals when connecting the replacement compressor (see **Table 4** for part numbers). If the suction and discharge manifolds are brazed to the compressor, carefully cutting the piping connections close the compressor stubs usually allows connection of the replacement compressor with couplings and short lengths of copper piping. **Do not attempt to unbrazed the piping from the failed compressor.**

Care must be used when removing the oil line connecting the compressor sumps. Catch pans should be placed under the compressor oil fittings to catch oil that may flow out of the compressors when the oil line is removed. It is highly recommended to place plastic (polyethylene plastic that is available at any hardware store) under the compressors to catch any spilled oil. Always use new rotalock o-ring seals when connecting the oil line to the replacement compressor (see **Table 4** for part numbers).

Start-up of a New or Replacement Compressor

It is good service practice, when charging a system with a scroll compressor, to charge liquid refrigerant into the high side only. It is not good practice to dump liquid refrigerant from a refrigerant cylinder into the crankcase of a stationary compressor. If additional charge is required, charge liquid into the low side of the system with the compressor operating. **WARNING! Do not start the compressor while the system is in a deep vacuum.** Internal arcing may occur when any type of compressor is started in a vacuum. **NOTICE Do not operate the compressor without enough system charge to maintain at least 55 psig (3.8 bar) suction pressure for R-410A. Do not operate with a restricted suction or liquid line. Do not operate with the low pressure cut-out disabled.** Never install a system in the field and leave it unattended with no charge, a holding charge, or with the service valves closed without securely locking out the system. This will prevent unauthorized personnel from accidentally ruining the compressor by operating with no refrigerant flow.

As mentioned in the **Manifolded Applications** section, attention must be given to compressor oil levels when commissioning a new system and servicing an existing system. Oil levels should be checked with the compressor "off" and after the oil has had a chance to equalize between the compressors (for manifolded applications). If oil can't be seen in the sight-glass of the compressor, add oil until the sight-glass is approximately half full.

Field Troubleshooting CoreSense Communications Module

A solid green LED indicates the module is powered and operation is normal. A solid red LED indicates an internal problem with the module. If a solid red LED is encountered, power down the module (interrupt the T1-T2 power) for 30

seconds to reboot the module. If a solid red LED is persistent, change the CoreSense module.

CoreSense communicates **Warning** codes via a green flashing LED. **Warning** codes do not result in a trip or lockout condition. Alert codes are communicated via a red flashing LED. **Alert** codes will result in a trip condition and possibly a lockout condition.

Separate motor and scroll thermistor circuits are used with CoreSense (See the wiring diagram in **Figure 5**). **Table 7** lists the trip and reset values for motor and scroll thermistor circuits. With the CoreSense module in stand-alone mode (dip switch 8 turned "off" or down), similar troubleshooting procedures that are used with the Kriwan module can be applied to the CoreSense module.

Table 8 lists the flash code information for **Warning** and **Alert** codes along with code reset and troubleshooting information. For more information on CoreSense please refer to **AE8-1384**.

Copeland Scroll Compressor Functional Check

A functional compressor test with the suction service valve closed to check how low the compressor will pull suction pressure is not a good indication of how well a compressor is performing. Such a test may damage a scroll compressor. The following diagnostic procedure should be used to evaluate whether a Copeland Scroll compressor is working properly.

1. Proper voltage to the unit should be verified.
2. The normal checks of motor winding continuity and short to ground should be made to determine if the inherent overload motor protector has opened or if an internal motor short or ground fault has developed. If the protector has opened, the compressor must be allowed to cool sufficiently to allow it to reset.
3. Proper indoor and outdoor blower/fan operation should be verified.
4. With service gauges connected to suction and discharge pressure fittings, turn on the compressor. If suction pressure falls below normal levels, the system is either low on charge or there is a flow blockage in the system.
5. . If suction pressure does not drop and discharge pressure does not rise to normal levels, reverse

any two of the compressor power leads and reapply power to make sure compressor was not wired to run in reverse direction. If pressures still do not move to normal values, either the reversing valve (if so equipped) or the compressor is faulty. Reconnect the compressor leads as originally configured and use normal diagnostic procedures to check operation of the reversing valve.wired to run in reverse direction. If pressures still do not move to normal values, either the reversing valve (if so equipped) or the compressor is faulty. Reconnect the compressor leads as originally configured and use normal diagnostic procedures to check operation of the reversing valve.

6. To test if the compressor is pumping properly, the compressor current draw must be compared to published compressor performance curves using the operating pressures and voltage of the system. If the measured average current deviates more than $\pm 15\%$ from published values, a faulty compressor may be indicated. A current imbalance exceeding 15% of the average on the three phases should be investigated further. A more comprehensive trouble-shooting sequence for compressors and systems can be found in Section H of the Copeland Electrical Handbook, Form No. 6400.
7. Before replacing or returning a compressor: Be certain that the compressor is actually inoperable. As a minimum, recheck a compressor returned from the field in the shop or depot for Hipot, winding resistance, and ability to start before returning. More than one third of compressors returned to Copeland. for warranty analysis are determined to have nothing found wrong. They were misdiagnosed in the field as being inoperable. Replacing working compressors unnecessarily costs everyone.

25 to 40 Ton Scroll Nomenclature

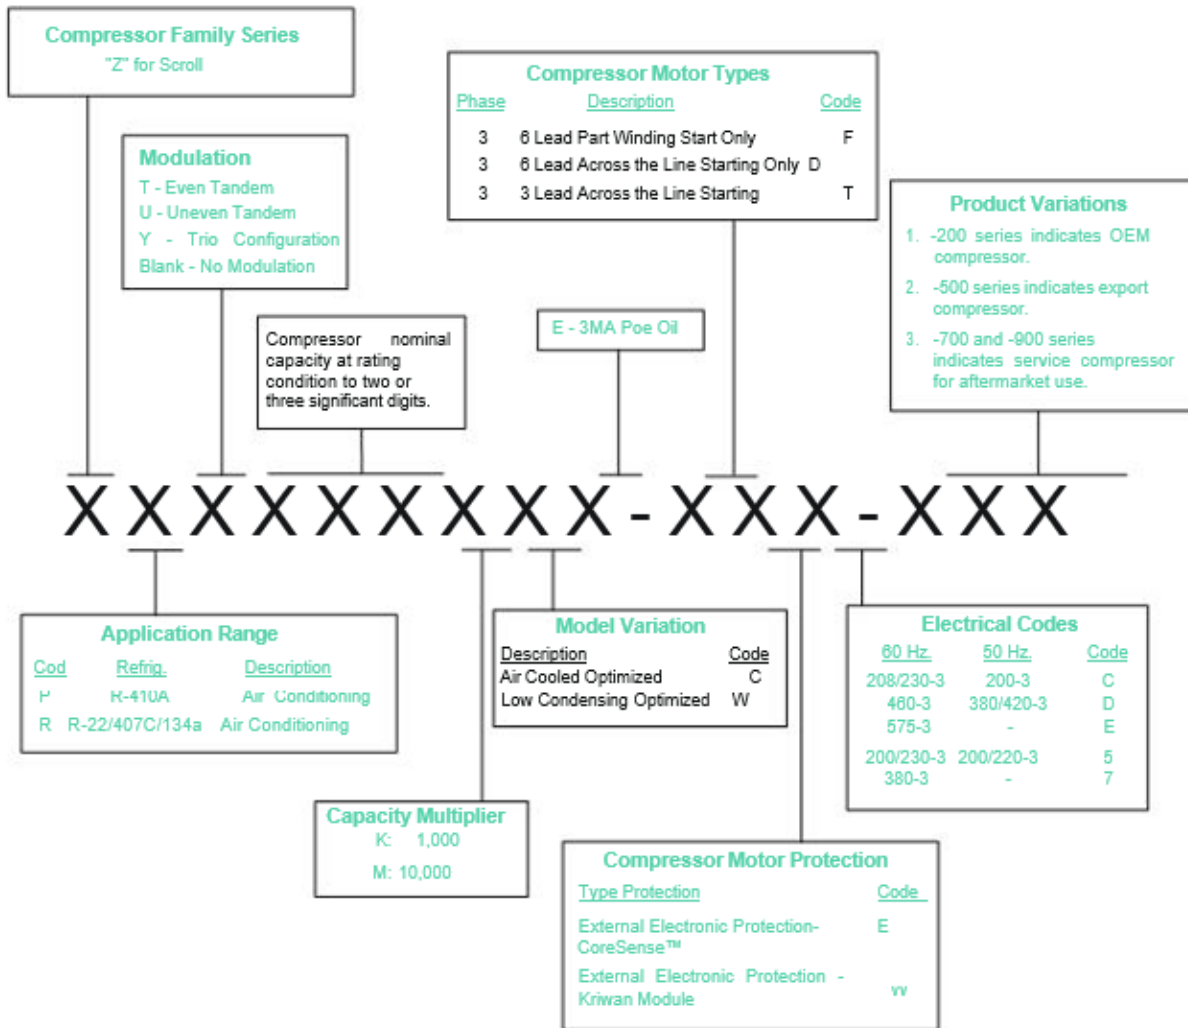


Figure 1 - Nomenclature

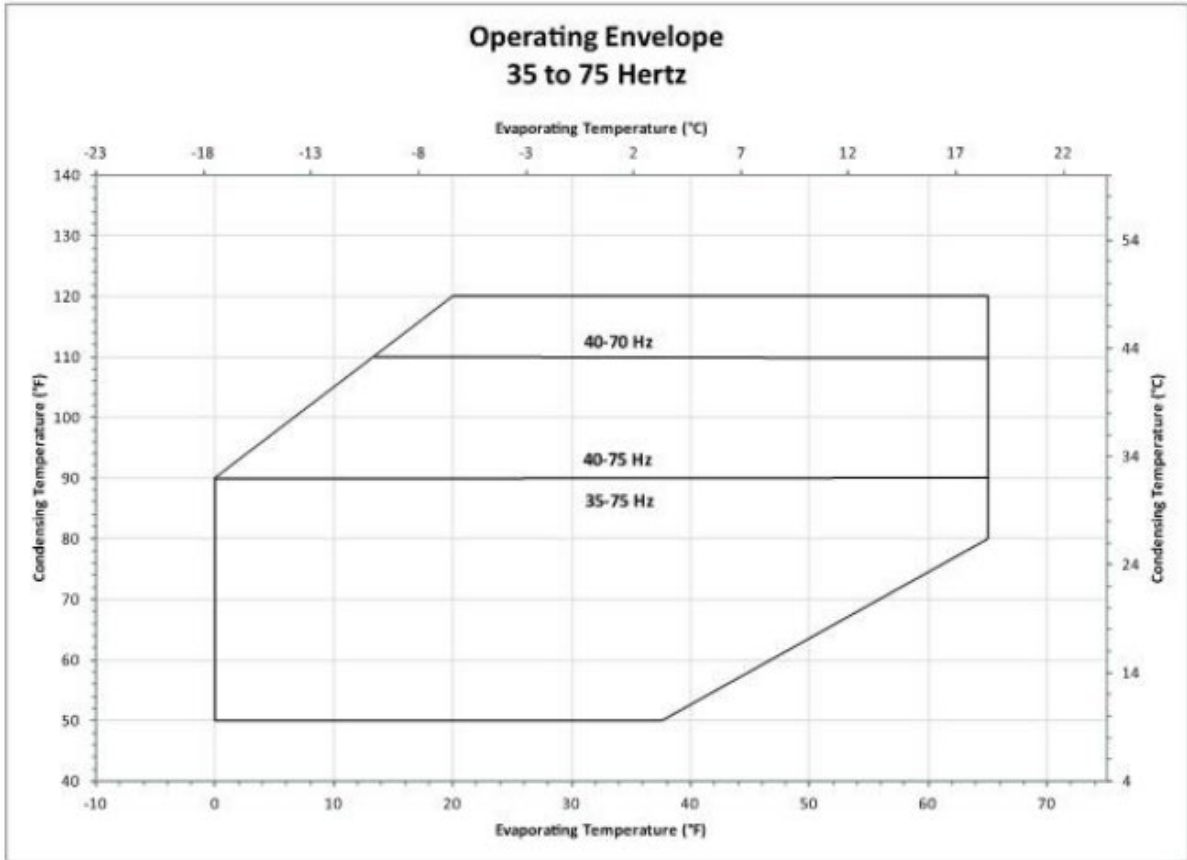


Figure 2 - 25 to 40 Ton Scroll Operating Envelope

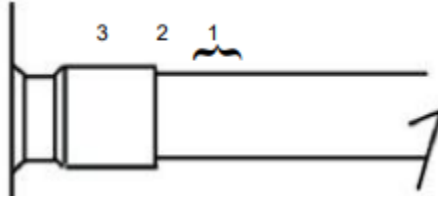


Figure 3
Scroll Suction Tube Brazing

New Installations

- The copper-coated steel suction tube on scroll compressors can be brazed in approximately the same manner as any copper tube.
- Recommended brazing materials: Any silfos material is recommended, preferably with a minimum of 5% silver. However, 0% silver is acceptable.
- Be sure suction tube fitting I.D. and suction tube O.D. are clean prior to assembly. If oil film is present wipe with denatured alcohol, DichloroTrifluoroethane or other suitable solvent.
- Using a double-tipped torch apply heat in Area 1. As tube approaches brazing temperature, move torch flame to Area 2.
- Heat Area 2 until braze temperature is attained, moving torch up and down and rotating around tube as necessary to heat tube evenly. Add braze material to the joint while moving torch around joint to flow braze material around circumference.
- After braze material flows around joint, move torch to heat Area 3. This will draw the braze material down into the joint. The time spent heating Area 3 should be minimal.

- As with any brazed joint, overheating may be detrimental to the final result.

Field Service



Remove refrigerant charge from both the low and high side of the compressor before cutting the suction and discharge lines to remove the compressor. Verify the charge has been completely removed with manifold gauges.

- To disconnect: Reclaim refrigerant from both the high and low side of the system. Cut tubing near compressor.
- To reconnect:
 - Recommended brazing materials: Silfos with minimum 5% silver or silver braze material with flux.
 - Insert tubing stubs into fitting and connect to the system with tubing connectors.
 - Follow New Installation brazing

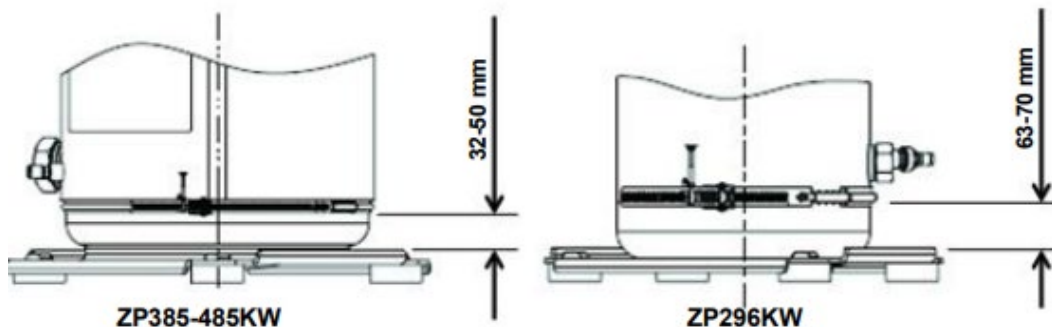


Figure 4 - Crankcase Heater Location

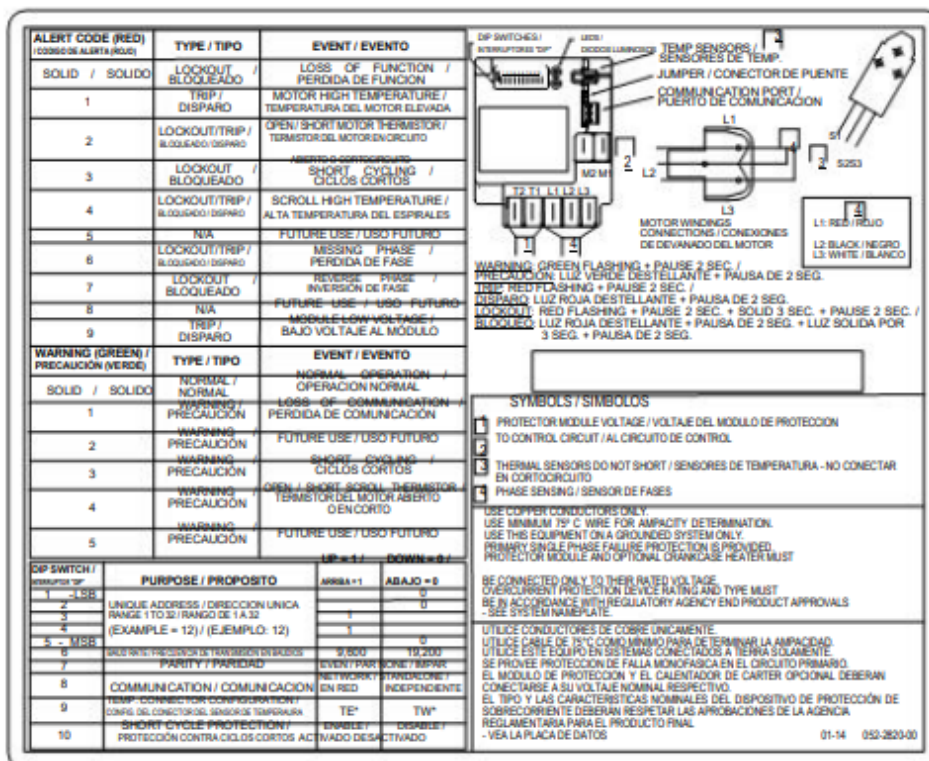


Figure 5a - ZP385/485 Terminal Box Wiring Diagram

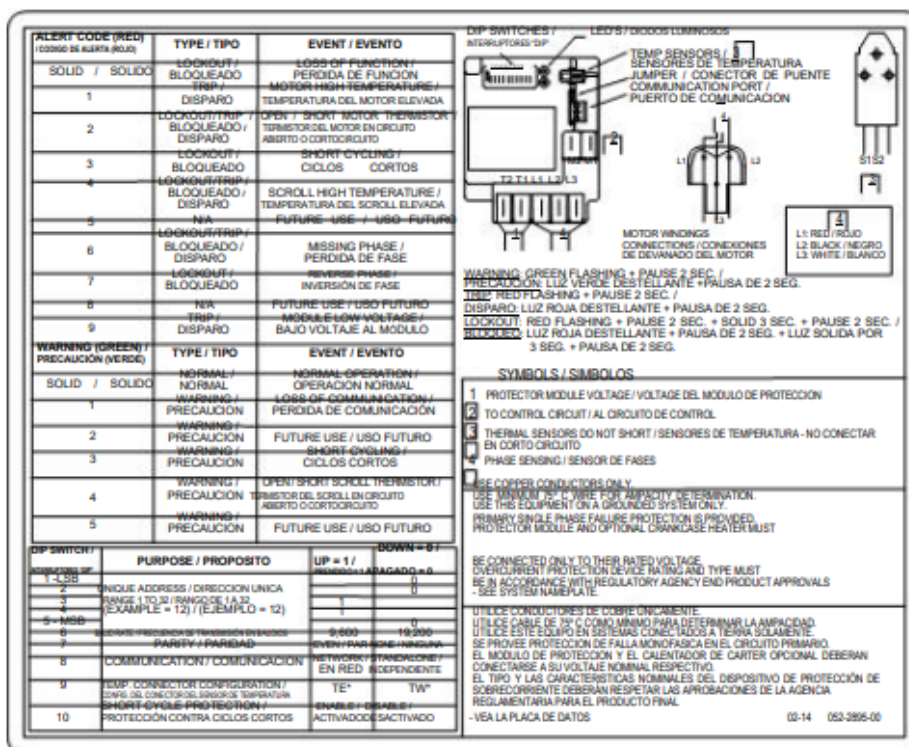


Figure 5b - ZP296 Terminal Box Wiring Diagram

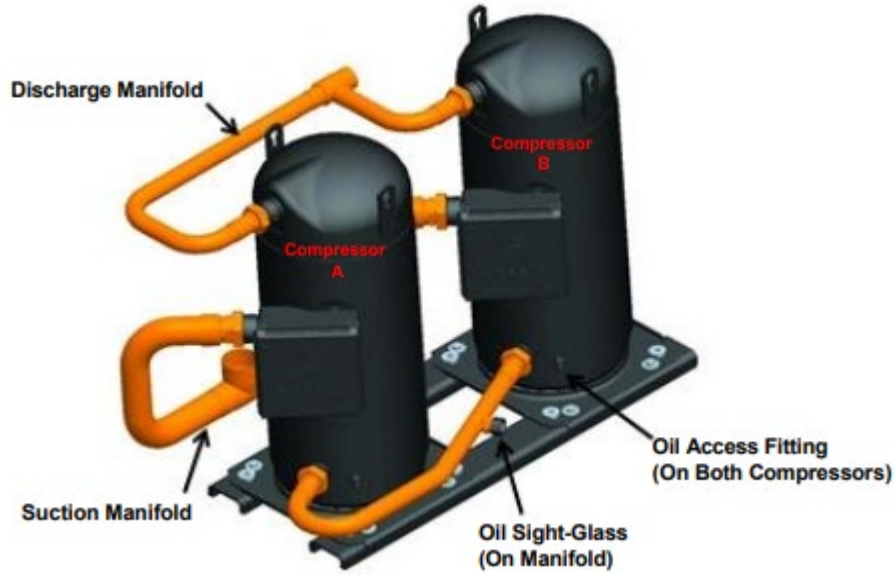


Figure 6 - Typical Rotalock Connected Tandem with TPTL Oil Manifold

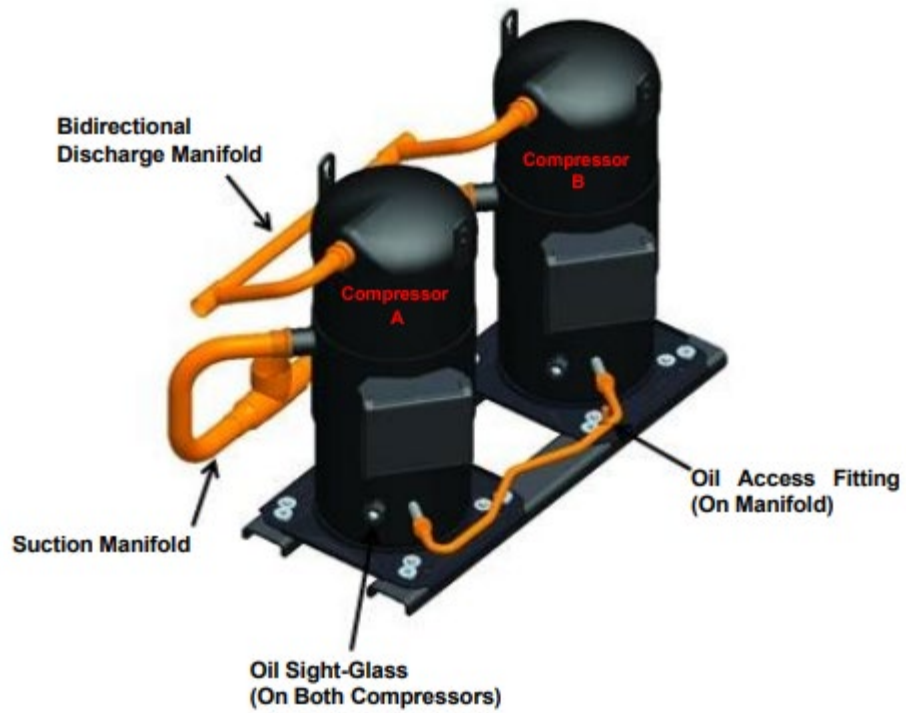


Figure 7 - Typical Braze Connected Tandem with OEL Oil Manifold



Figure 8 - Typical Braze Connected Trio with TPTL Oil Manifold

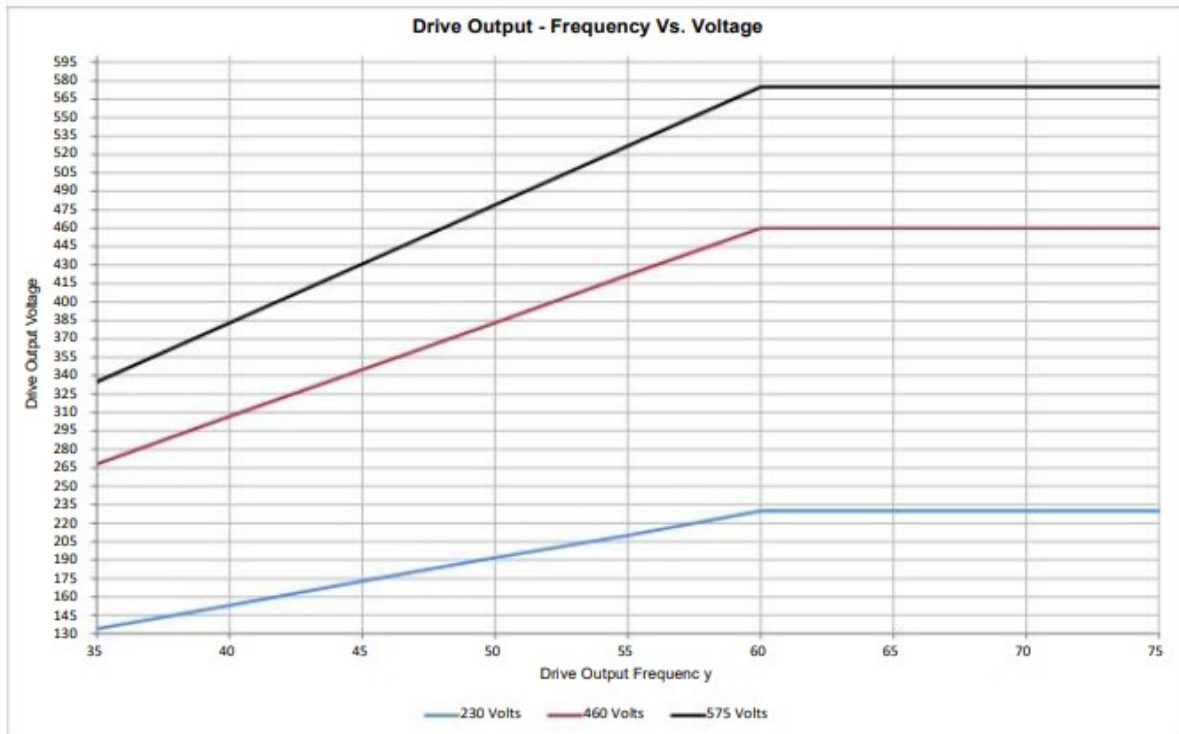


Figure 9 - Drive Output - Frequency vs. Voltage

Table 2
Torque Values

Part	Torque		
	ft-lb	in-lb	N-m
Sight-Glass	50-58	600-690	68-78
TPTL Rotalock Fitting	125-133	1500-1590	70-180
OEL Rotalock Fitting	50-58	600-690	68-78
Suction Rotalock (Valve or Adapter)	6140-148	1680-1770	190-200
Discharge Rotalock (Valve or Adapter)	125-133	1500-1590	170-180
Schrader Valves	17-18	200-220	22.6-24.0
Oil Access Fitting (Threads into Oil Rotalock)		40-60	4.5-6.8
Terminal Block Screws		25	2.8
Tandem Mounting Bolts (M10)	33-41	398-487	45-55

Table 3
Refrigerant Charge Limits

Model	Charge Limit	
	Pounds	Kg
ZP296KW	25	11.3
ZP385-485KW	30	13.6
ZP Tandems	45	20.4
ZP Trios	65	29.5

Table 4 - Compressor Accessories

Part Category	Part Description	ZP296	ZP385	ZP485
Mounting	Spacer-Mounting Kit	527-0175-02	527-0175-02	527-0175-02
Crankcase Heater	Crankcase Heater, 120V	018-0091-27	018-0091-10	018-0091-10
	Crankcase Heater, 240V	018-0091-25	018-0091-09	018-0091-09
	Crankcase Heater, 480V	018-0091-26	018-0091-08	018-0091-08
	Crankcase Heater, 575V	018-0091-28	018-0091-11	018-0091-11
	Crankcase Heater Junction Box	962-0001-03	962-0001-03	962-0001-03
Oil	Oil Sight-Glass	070-0040-00	970-0021-00	970-0021-00
	Oil Access Fitting	510-0715-00	510-0370-00	510-0715-00
Electrical	Terminal Box Assembly ¹			
	Terminal Block	021-0332-00	021-0332-00	021-0332-00
	Terminal Block Screws (Zinc Plated 10-32 UNF-2A x .5" Long) ²	100-0550-01	100-0550-01	100-0550-01
Protection	CoreSense Module ³ 120/240V	971-0064-05	971-0064-05	971-0064-05
	CoreSense Module ³ 24V	971-0065-04	971-0065-04	971-0065-04
Suction & Discharge	Suct & Disch 1/4" Schrader Fittings	510-0370-00	510-0370-00	510-0370-00
	Discharge Rotalock O-Ring Sea	020-0028-05	020-0028-05	020-0028-03
	Suction Rotalock O-Ring Seal	020-0941-00	020-0941-00	020-0941-00
	Rotalock Service Valve, Disc 1-3/8"	998-0510-46	998-0510-46	998-0510-46
	Rotalock Service Valve, Suct 1-5/8"	998-0510-68	998-0510-68	998-0510-68
	Disc Rotalock Adapter to 1-3/8" Sweat	934-0002-00	934-0002-00	934-0002-00
	Suct Rotalock Adapter to 1-5/8" Sweat	934-0002-01	934-0002-01	934-0002-01

¹ Terminal boxes are rarely replaced; please contact Application Engineering if replacement part numbers are required.

² Can be purchased locally

³ Includes phase sensing wires and thermistor harness

Table 5 - Tandem Quick Reference Guide

Tandem Model	Compressor		Drawing #	Compressor Connections			Discharge Manifold	Oil Line		Flow Washers		Piping Restrictions
	"A"	"B"		Rotalock	Brazed	Flanged		OEL	TPTL	Comp."A"	Comp."B"	
ZPT592KW	ZP296	ZP296	497-1184-00		X		bi-directional	X				A minimum of 18" of straight piping upstream of the suction "T" is required
	ZP296	ZP296	497-1185-00	X			bi-directional	X				
ZPU681KW	ZP385	ZP296	497-1316-00		X		bi-directional	X			X	
ZPT770KW	ZP385	ZP385	497-3589-00	X			one direction	X				
	ZP385	ZP385	497-1348-00	X			bi-directional	X				
	ZP385	ZP385	497-1346-00		X		bi-directional	X				
ZPU870KW	ZP385	ZP485	497-0814-00	X			one direction		X	X		
	ZP385	ZP485	497-1484-00	X			bi-directional		X			
ZPT970KW	ZP485	ZP485	497-1122-00		X		bi-directional	X				
	ZP485	ZP485	497-1486-00	X			bi-directional	X				

Notes:

¹ Compressor "A" is the compressor on the left, when looking at the assembly from the terminal box side of the compressor.

Table 6 - Trio Quick Reference Guide

Trio Model	Compressor 3X	Drawing #	Compressor Connections		Discharge Manifold	Oil Line	Flow Washers			Piping Restrictions
			Rotalock	Brazed			Comp "A"	Comp "B"	Comp "C"	
						TPTL				
ZPY115MW	ZP385KW	497-0385-04	X		unidirectional	X			X	suction flow direction from the "C" compressor direction
		497-0385-05		X	unidirectional	X			X	
		497-0385-06	X		unidirectional	X			X	suction flow direction from the "A" compressor direction
		497-0385-07		X	unidirectional	X	X		X	
		497-0385-02	X		unidirectional	X	X			3-5/8" suction connection, 18" of straight suction piping
		497-0385-03		X	unidirectional	X				
ZPY888KW	ZP296KW	497-1389-00	X		unidirectional	X				3-5/8" suction connection, 18" suction piping required
		497-1390-00		X	unidirectional	X				
ZPY145MW	ZP485KW	497-1265-00	X		bidirectional	X				3-5/8" suction connection, 18" of straight suction piping required
		497-1264-00		X	bidirectional	X				

¹ Compressor "A" is the compressor on the left, when looking at the assembly from the terminal box side of the compressor. Compressor "B" is the middle compressor and compressor "C" is on the right.

Table 7 - CoreSense Specifications

Module P/N	571-0065-05	571-0064-06
Compressor Motor Code	TE	TE
Type	CoreSense ¹	CoreSense ¹
T1-T2 Voltage (AC)	24	120/240
Power Consumption (VA)	5	5
M1-M2 Contact Rating (A)	2.5	2.5
M1-M2 Minimum Current (A)	N/A	N/A
M1-M2 Maximum Voltage	240	240
Trip Point (Ω)	>4.5K Ω (motor) <2.4K Ω (scroll)	>4.5K Ω (motor) <2.4K Ω (scroll)
Reset Point (Ω)	>2.75K Ω (motor) >5.1K Ω (scroll)	>2.75K Ω (motor) >5.1K Ω (scroll)
Reset Time	30 minutes	30 minutes
Features	Motor & Scroll Temperature, Phase Protection, Communications	

¹ Refer to AE8-1384

The contents of this publication are presented for informational purposes only and are not to be construed as warranties or guarantees, express or implied, regarding the products or services described herein or their use or applicability. Copeland LP and/or its affiliates (collectively "Copeland"), as applicable, reserve the right to modify the design or specifications of such products at any time without notice. Copeland does not assume responsibility for the selection, use or maintenance of any product. Responsibility for proper selection, use and maintenance of any Copeland product remains solely with the purchaser or end user.

Table 8 - CoreSense Communications LED Flash Code Information

The flash code number corresponds to the number of LED flashes, followed by a pause, and then the flash code is repeated. A lockout condition produces a red flash, followed by a pause, a solid red, a second pause, and then repeated

Status	Fault Condition	Code Fault Description	Code Reset Description	Troubleshooting Information
Solid Green	Normal Operation	Module is powered and operation is normal	N/A	N/A
Solid Red	Module Malfunction	Module has internal fault	N/A	1) Reset module by removing power from T2-T1 2) Replace module
Warning LED Flash				
Green Flash Code 1	Loss of Communication	Module and master controller have lost communications with each other for more than 5 minutes	When communications are confirmed	1) Check the control wiring 2) Verify dipswitch 8 is "on"
Green Flash Code 2	Future Use	N/A	N/A	N/A
Green Flash Code 3	Short Cycling	Run time of less than 1 minute; number of short cycles exceeds 48 in 24 hours	< 48 short cycles in 24 hours	1) Check system charge and pressure control setting 2) Adjust set-point of temperature controller 3) Install anti-short cycling control
Green Flash Code 4	Open/Shorted Scroll Thermistor	$\Omega > 3/0K$ or $\Omega < 1K$	$5.1K < \Omega < 3/0K$	1) Check for poor connections at module and thermistor fusite 2) Check continuity of thermistor wiring harness
Green Flash Code 5	Future Use	N/A	N/A	N/A
Alert/Lockout LED Flash				
Red Flash Code 1	Motor High Temperature	$\Omega > 4.5K$; Lockout after 5 Alerts	$\Omega < 2.75K$ and 30 minutes	1) Check supply voltage 2) Check system charge & superheat 3) Check contactor
Red Flash Code 2	Open/Shorted Motor Thermistor	$\Omega > 220K$ or $\Omega < 40$; lockout after 6 hours	$40 < \Omega < 2.75K$ and 30 minutes	1) Check for poor connections at module and thermistor fusite 2) Check continuity of thermistor wiring harness
Red Flash Code 3	Short Cycling	Run time of less than 1 minute; lockout if the number of Alerts exceeds the number configured by the user in 24 hours	Interrupt power to T2-T1 or perform Modbus reset command	1) Check system charge and pressure control setting 2) Adjust set-point of temperature controller 3) Install anti-short cycling control

Table 8 Continued

Status	Fault Condition	Code Fault Description	Code Reset Description	Troubleshooting Information
Red Flash Code 4	Scroll High Temperature	$\Omega < 2.4K$; Lockout if the number of Alerts exceeds the number configured by the user in 24 hours	Interrupt power to T2-T1 or perform Modbus reset command	1) Check system charge and superheat 2) Check system operating conditions 3) Check for abnormally low suction pressure
Red Flash Code 5	Future Use	N/A	N/A	N/A
Red Flash Code 6	Missing Phase	Missing phase; Lockout after 10 consecutive Alerts	After 5 minutes and missing phase condition is not present	1) Check incoming power 2) Check fuses/breakers 3) Check contactor
Red Flash Code 7	Reverse Phase	Reverse phase; Lockout after 1 Alert	Interrupt power to T2-T1 or perform Modbus reset command	1) Check incoming phase sequence 2) Check contactor 3) Check module phasing wires A-B-C
Red Flash Code 8	Future Use	N/A	N/A	N/A
Red Flash Code 9	Module Low Voltage	Low voltage on T2-T1 Terminals ¹	After 5 minutes and the voltage is back in the normal range	1) Verify correct module p/n 2) Check VA rating of transformer 3) Check for blown fuse in transformer secondary

¹ This Alert does not result in a Lockout

Table 9 - Copeland Drive Selections

Model	Compressor Voltage	Frequency (Hz)	Phase	Drive Name	Drive Model Number	Maximum Continuous Output Current
ZP296KWE-TE5	200/230	60	3	H Series	H300-072 01170A	117
ZP296KWE-TE7	380/400	60	3	H Series	H300-074 00790A	79
ZP296KWE-TED	380/420	50	3	H Series	H300-064 00630A	63
ZP296KWE-TED	460	60	3	H Series	H300-064 00630A	63
ZP296KWE-TEE	575	60	3	H Series	H300-065 00430A	43
ZP385KWE-TE5	200/230	60	3	H Series	H300-082 01490A	149
ZP385KWE-TE7	380/400	60	3	H Series	H300-074 00940A	94
ZP385KWE-TED	460	60	3	H Series	H300-074 00790A	79
ZP385KWE-TEE	575	60	3	H Series	H300-075 00730A	73
ZP485KWE-TED	460	60	3	H Series	H300-074 00940A	94
ZP485KWE-TE7	380/400	60	3	H Series	H300-084 01550A	155
ZP485KWE-TEE	575	60	3	H Series	H300-075 00730A	73
ZP485KWE-DE5	200/220	60	3	H Series	H300-092 02160E	216

The drive selections are for a maximum frequency of 60 Hz. If operating at greater than 60 Hz, please contact Application Engineering for drive selections